D116

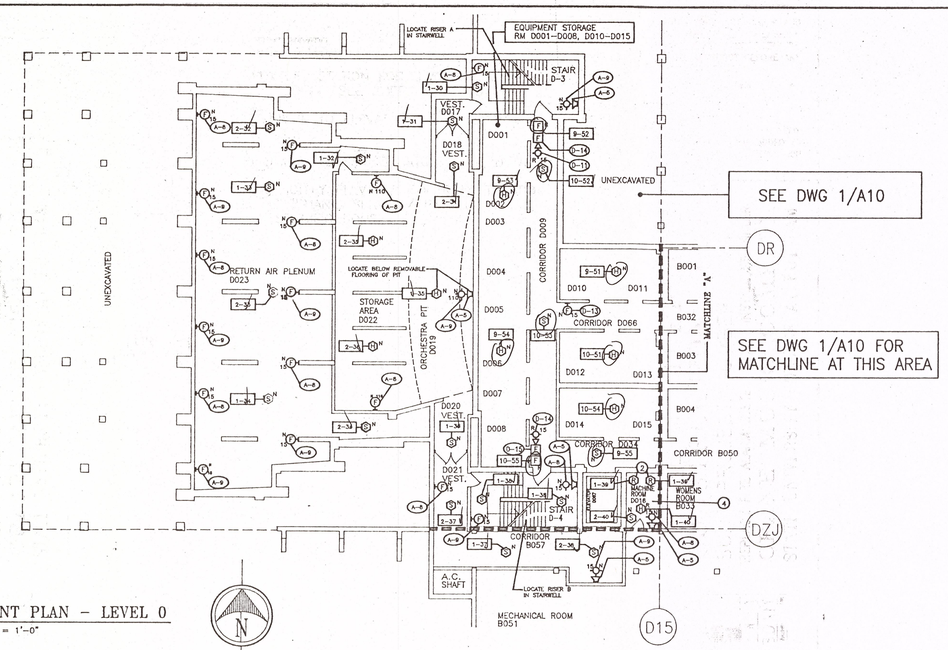

1/A1 BASEMENT PLAN – LEVEL 0

SCALE: 1/16" = 1'-0"

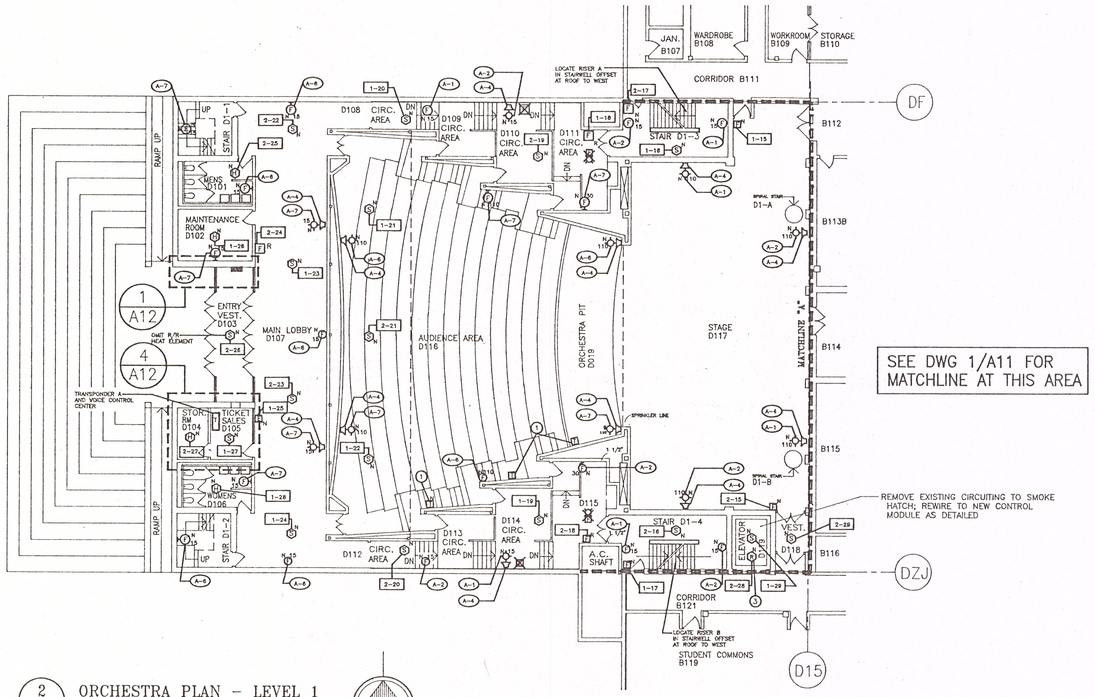

2/A1 ORCHESTRA PLAN – LEVEL 1

SCALE: 1/16" = 1'-0"

KEY NOTES:

1. TEST STATION FOR BEAM SMOKE DETECTOR ABOVE. SEE SHEET A-2 AND DETAIL.
2. WIRE TO ELEVATOR RECALL SYSTEM. SEE DETAIL
3. WIRE TO SMOKE HATCH. SEE DETAIL.
4. MODIFY ELEVATOR CONTROLS TO ADD FIREMAN'S SERVICE/ RECALL. SEE SPECIFICATIONS.

KEY PLAN: CRANE MUSIC COMPLEX

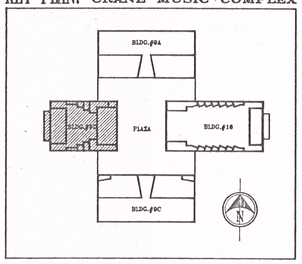

SNELL MUSIC THEATER (BLDG. NO. 9D)

CONTRACTOR SHALL CHECK AND FIELD VERIFY ALL DIMENSIONS AND REPORT DISCREPENCIES TO THE ARCHITECT BEFORE ANY WORK IS COMMENCED.

ALL DRAWINGS ARE THE PROPERTY OF THE ARCHITECT.

THIS DESIGN AND THESE DOCUMENTS MAY NOT BE REPRODUCED, REUSED, ALTERED OR ADDED TO WITHOUT THE WRITTEN PERMISSION OF THE ARCHITECT.

STATE UNIVERSITY CONSTRUCTION FUND
SUCF PROJECT NUMBER 12130
REPLACE FIRE ALARM SYSTEM / INSTALL SPRINKLER
CRANE MUSIC COMPLEX
STATE UNIVERSITY COLLEGE AT POTSDAM

S·U·N·Y POTSDAM

HA2F, CONSULTANTS IN ENGINEERING
P.O. BOX 226
CLIFTON PARK, NY. 12065
TEL: (518) 877-8506
FAX: (518) 877-8509

OCM PROJECT NO. 10233

O'CONNOR & MARSH
ARCHITECTS
FACILITY DESIGN – PLANNING
517 OVER THE LIBRARY
WESTERN AVENUE
ALBANY, NEW YORK 12203
518 459 0611

DRAWING TITLE
SNELL HALL –
LEVEL 0, & LEVEL 1

DATE	DRAWING NO.
12-9-97	A1
SUCF PROJECT NO. 12130	